
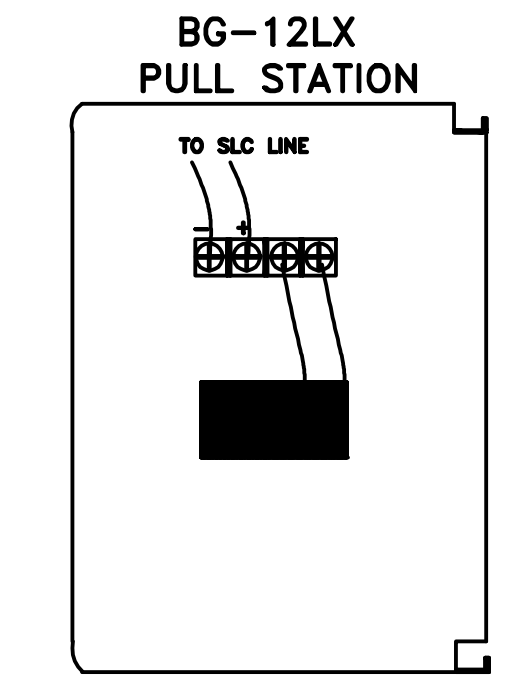
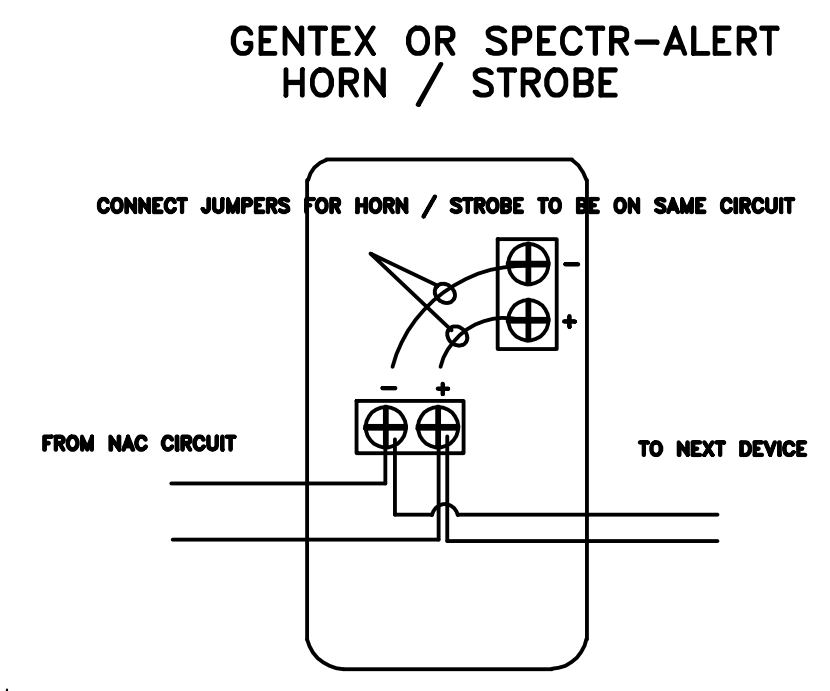


**NFPA 72 AND ADA DEVICE
INSTALLATION REQUIREMENTS**

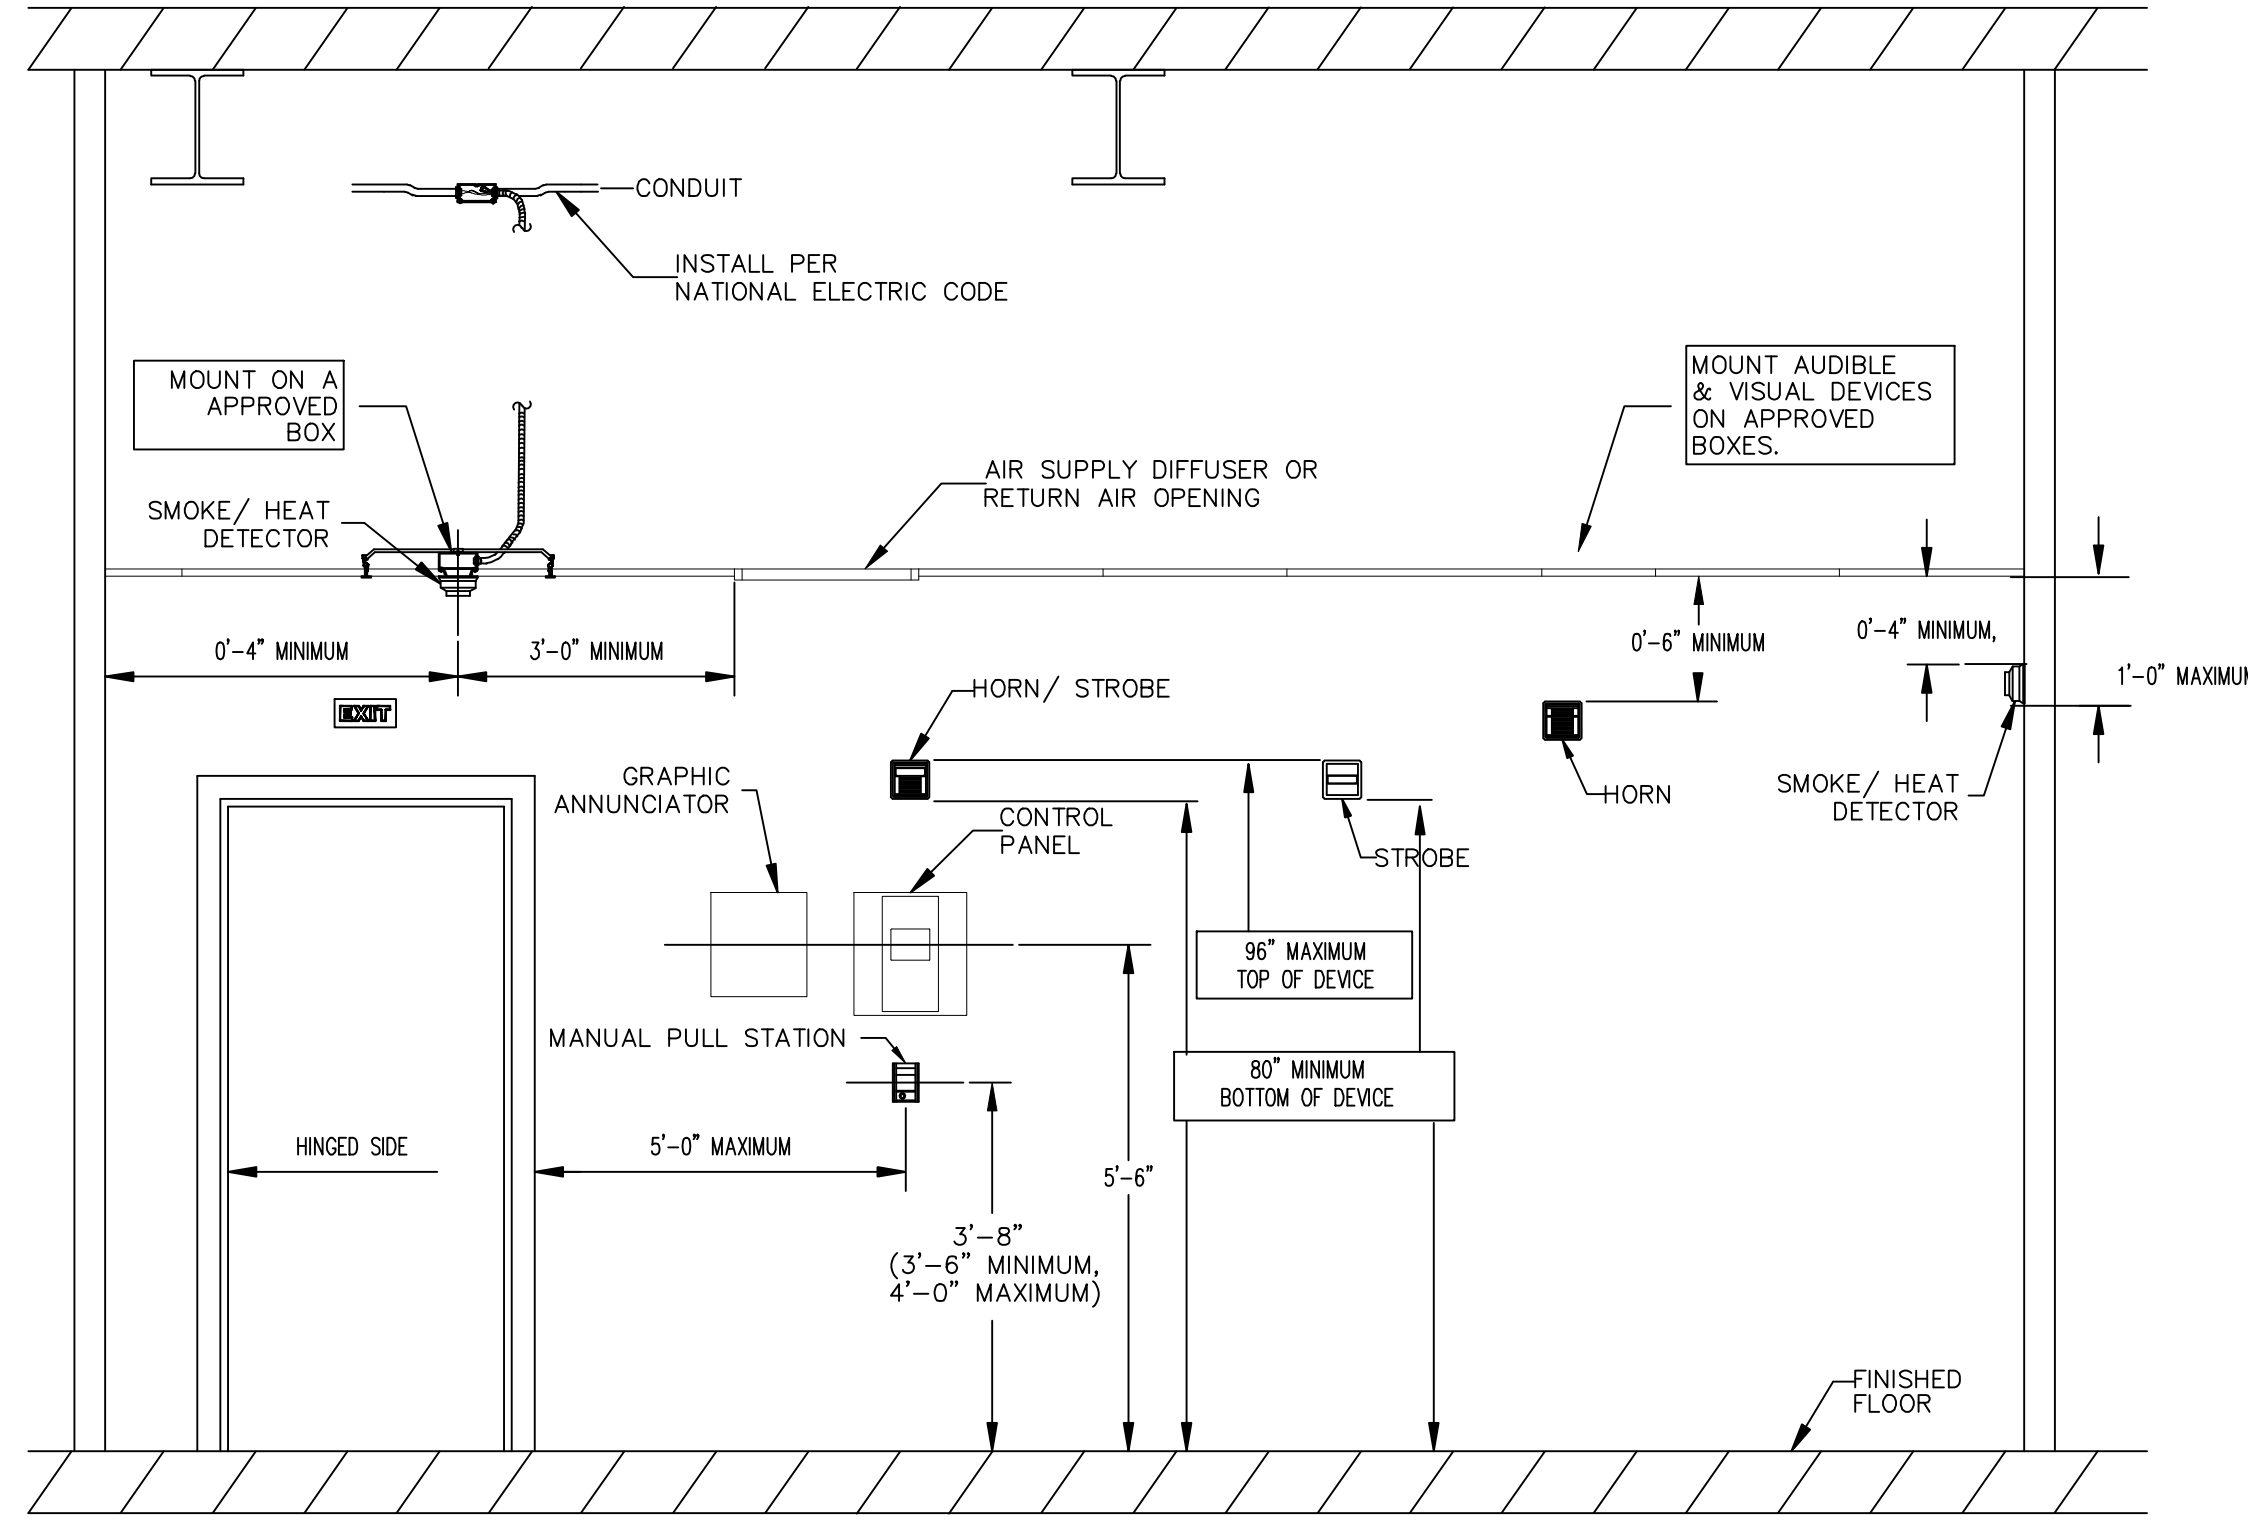





WIRE LEGEND

NAC CIRCUITS SHALL BE: 18-2 NON-SHIELDED FIRE ALARM CABLE

SLC LOOP SHALL BE: 18-2 SHIELDED FIRE ALARM CABLE

GENERAL NOTES

CONTRACTOR SHALL INSURE THAT ALL EQUIPMENT AND INSTALLATION FOLLOWS NFPA72 STANDARDS.

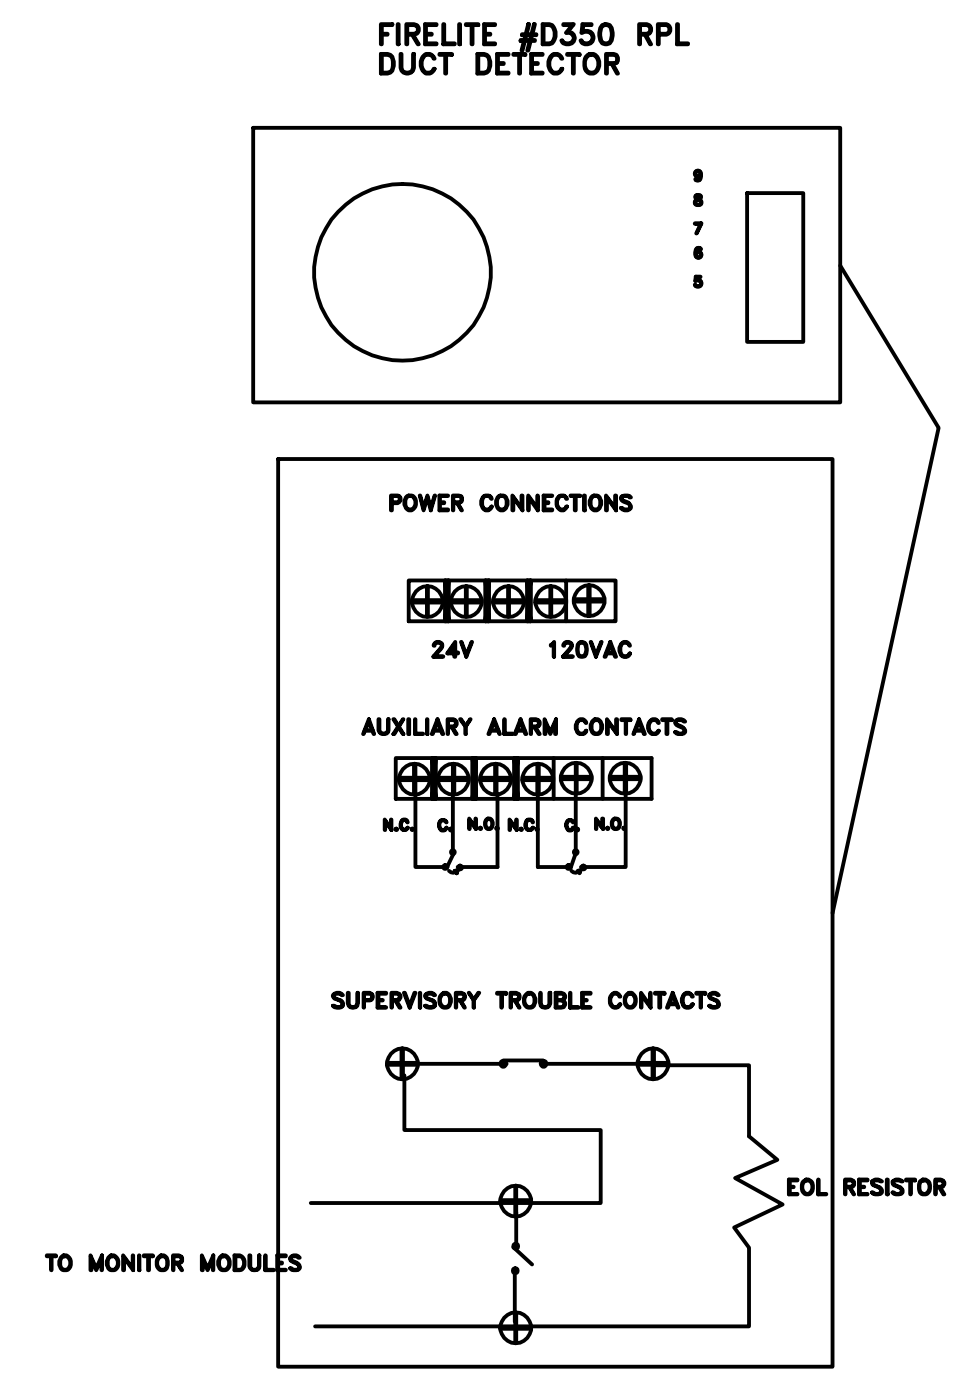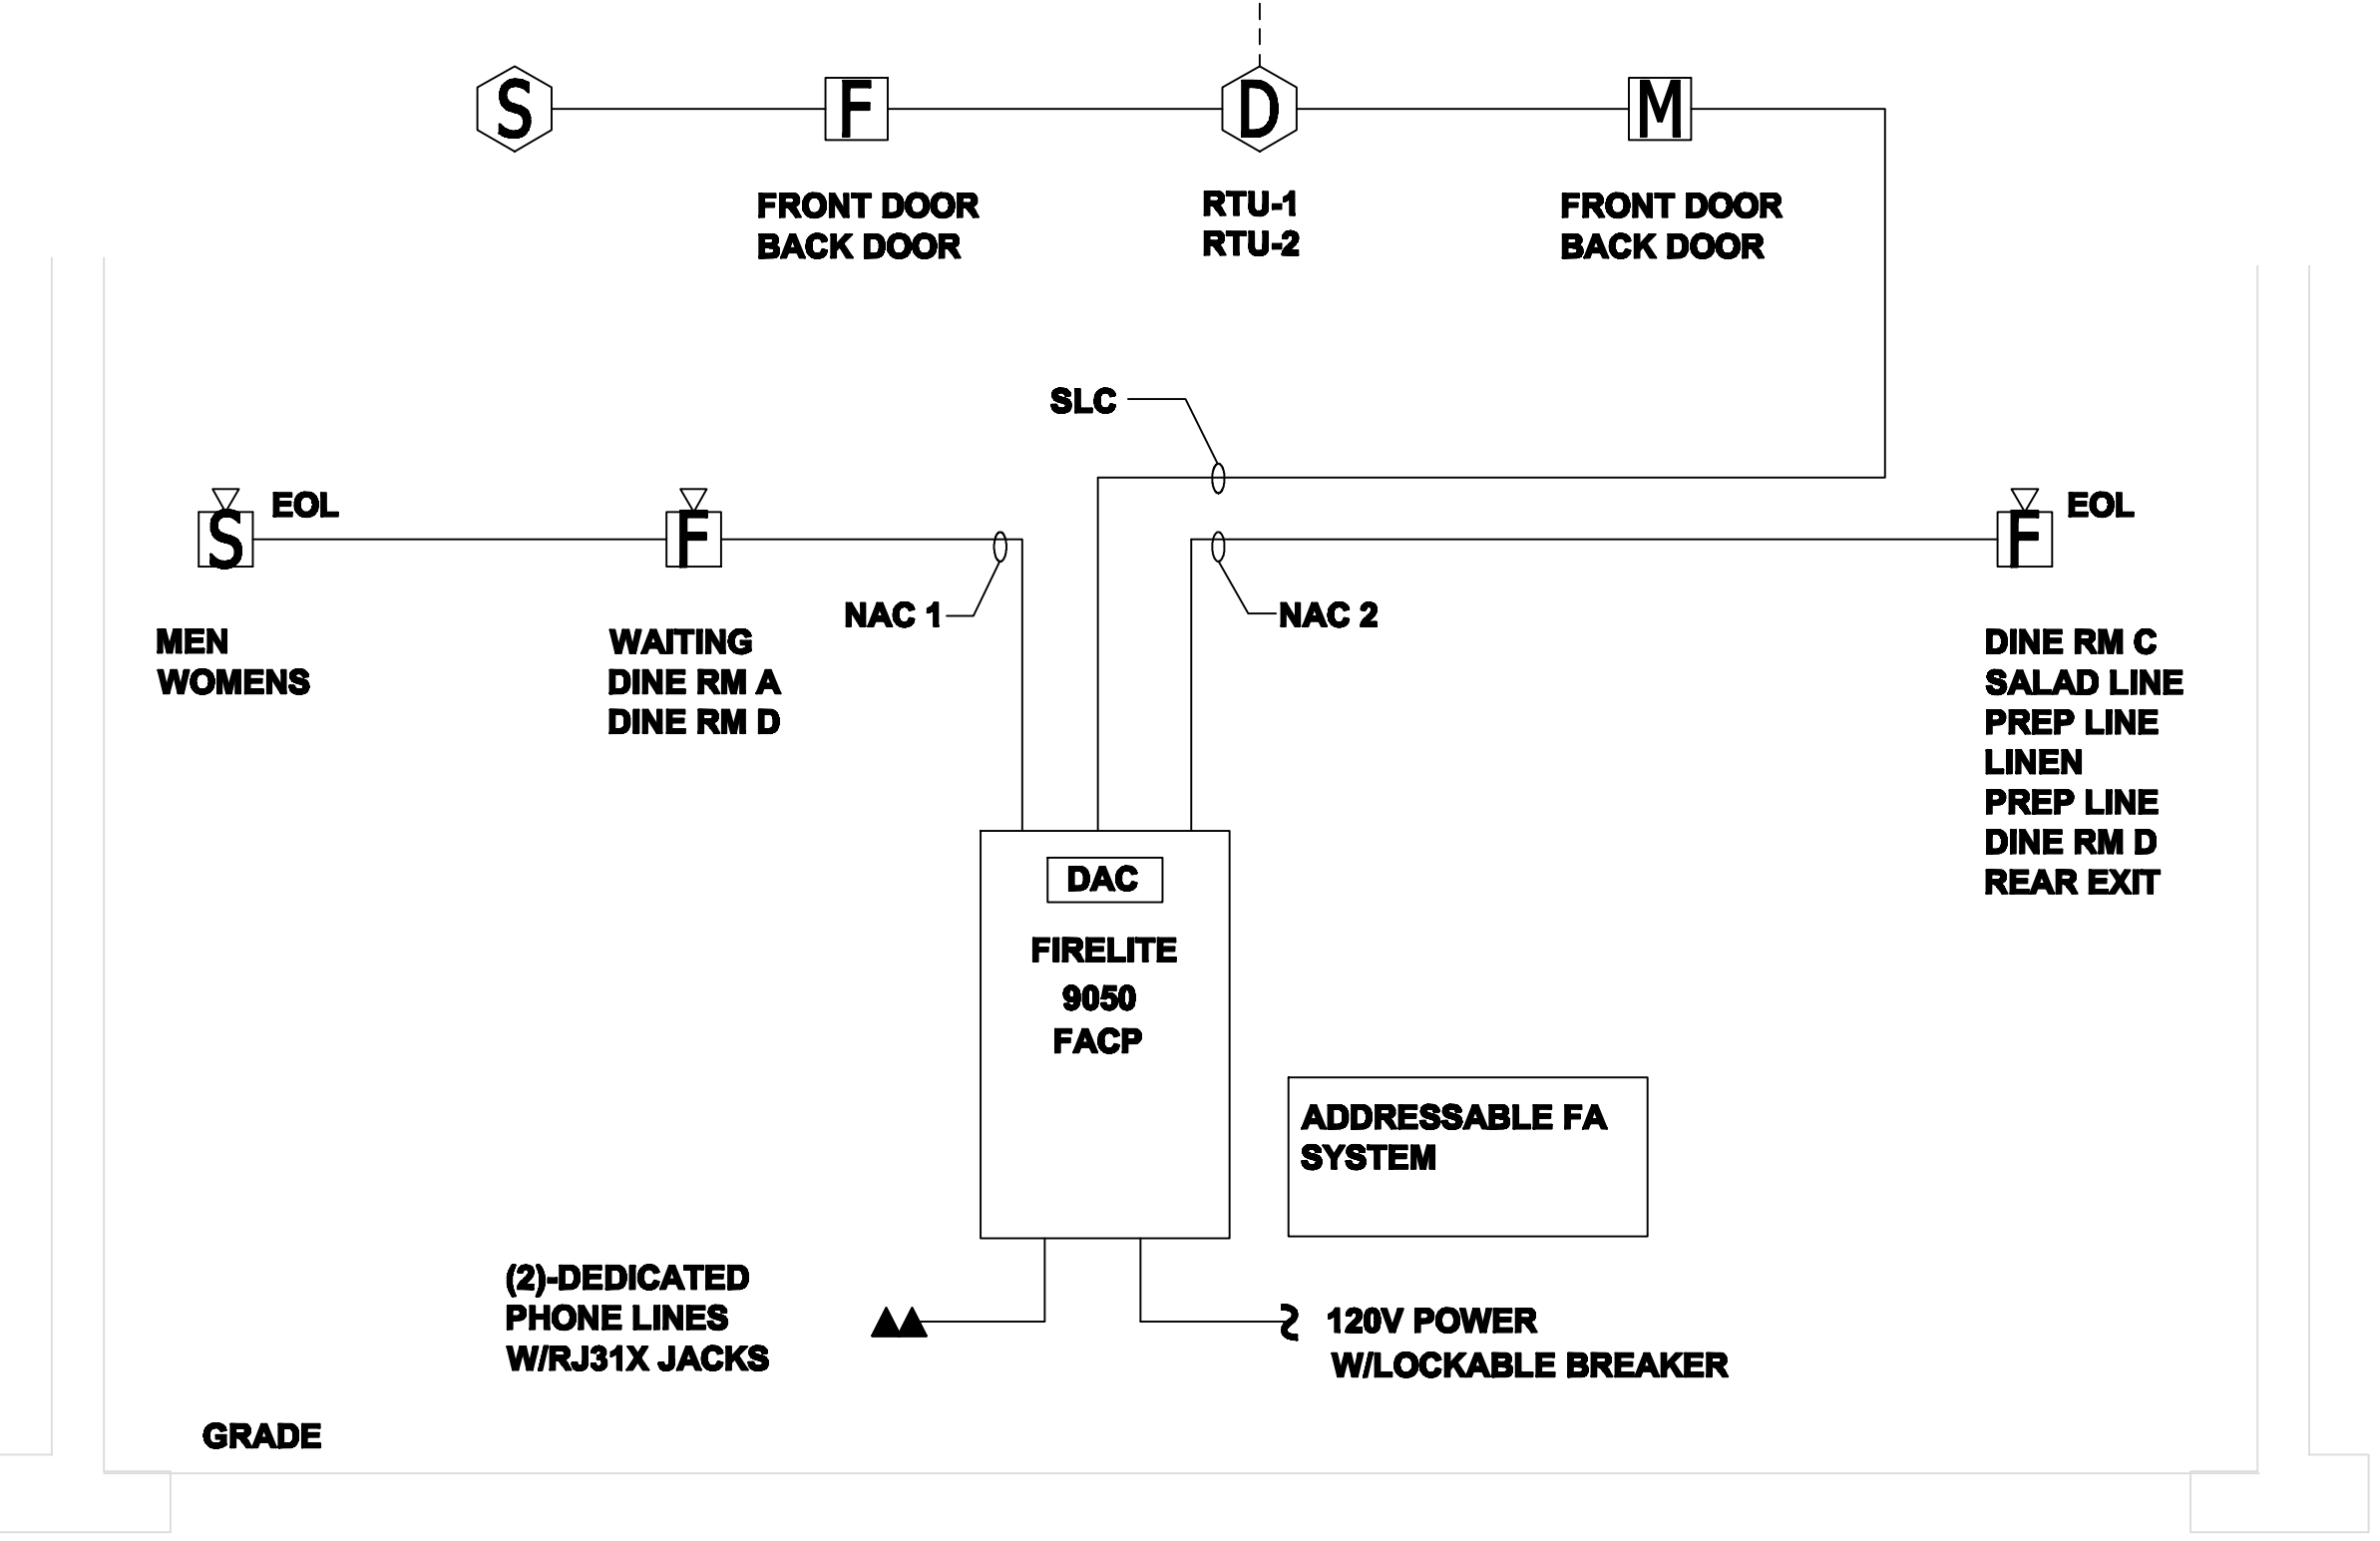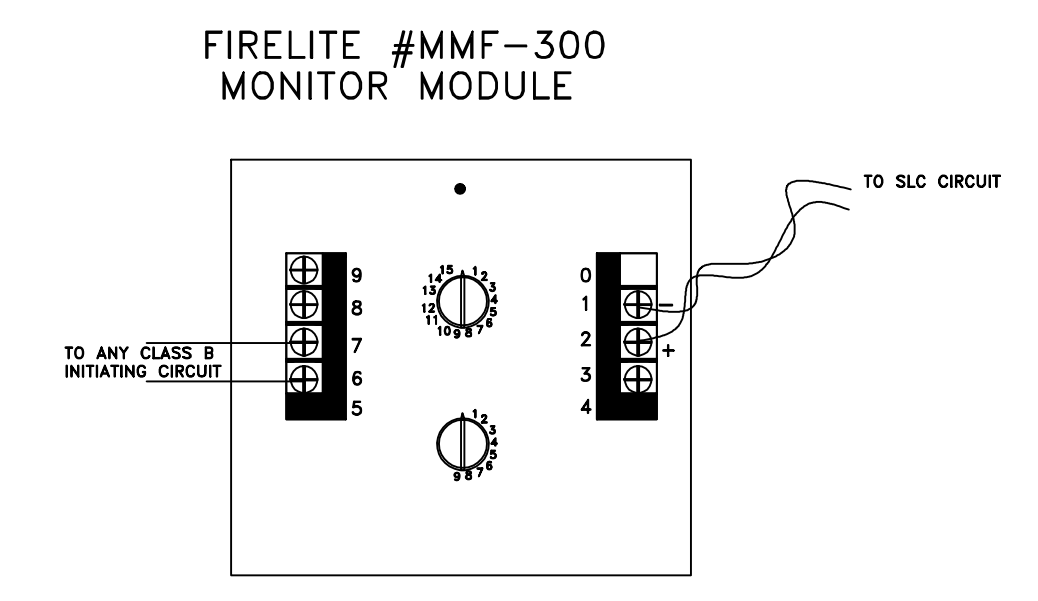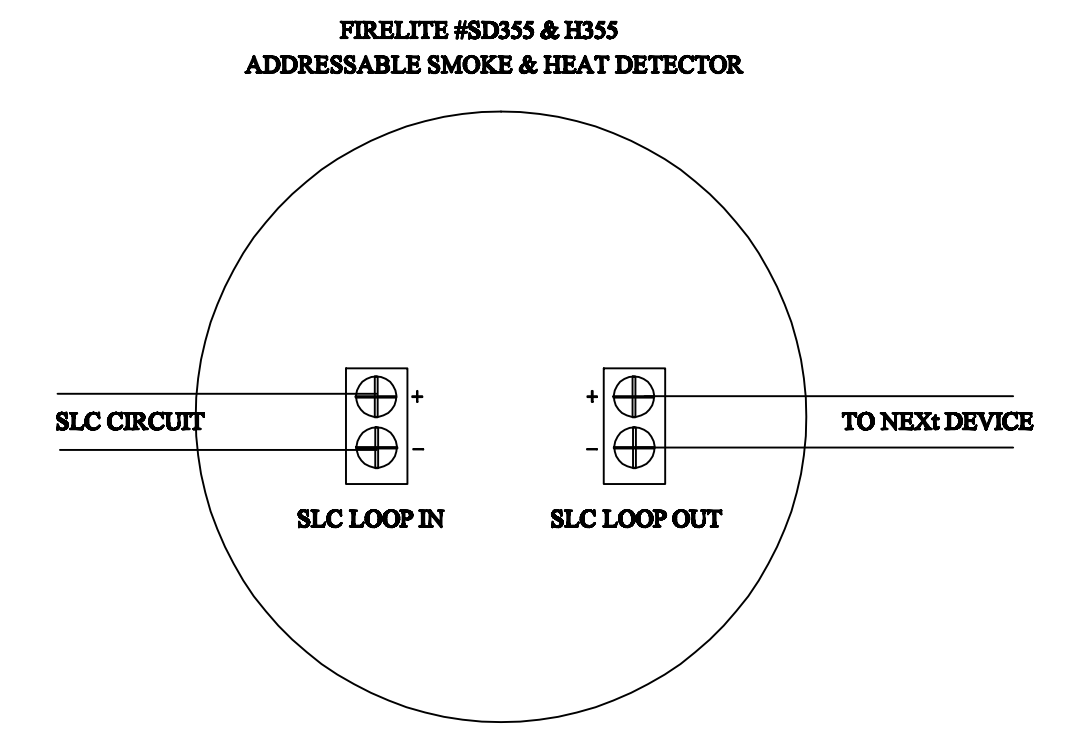

THE PYROCADD COMPANY, LLC
A FIRE SYSTEM DESIGN FIRM
9713 SAINT JOHNS CHURCH RD
ZEBULON, NC 27597
WWW.PYROCADD.COM

PHONE: 919-375-4486
EMAIL: PYROCADD@GMAIL.COM

This drawing and the design shown are the property of THE PYROCADD COMPANY. The reproduction, copying or other use of this drawing without the written consent is prohibited. © 2009 THE PYROCADD COMPANY, LLC

FIRE ALARM SYSTEM FOR:
OASIS SOUTHWEST GRILL
STEELE ROAD
FRANKLIN, KY 42134

PROJECT NO: 102-66
DATE: 5/9/09
CAD DWG FILE:
DRWN BY: DWR CHKD BY: DWR

FIRE ALARM RISER, DETAILS

FA1

1 FA1 FIRE ALARM RISER
NTS