

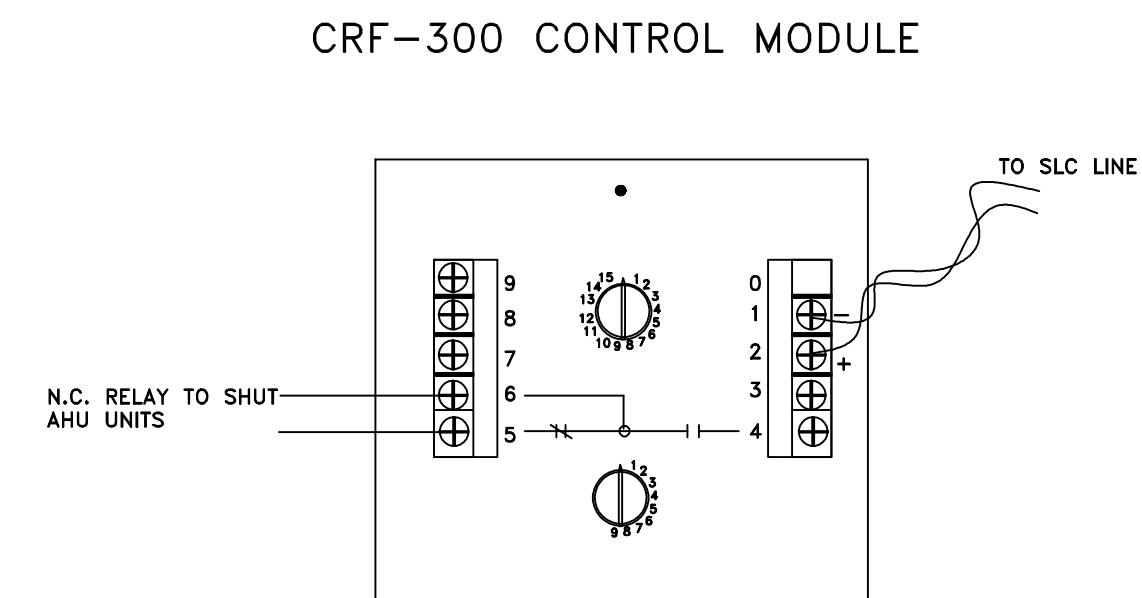



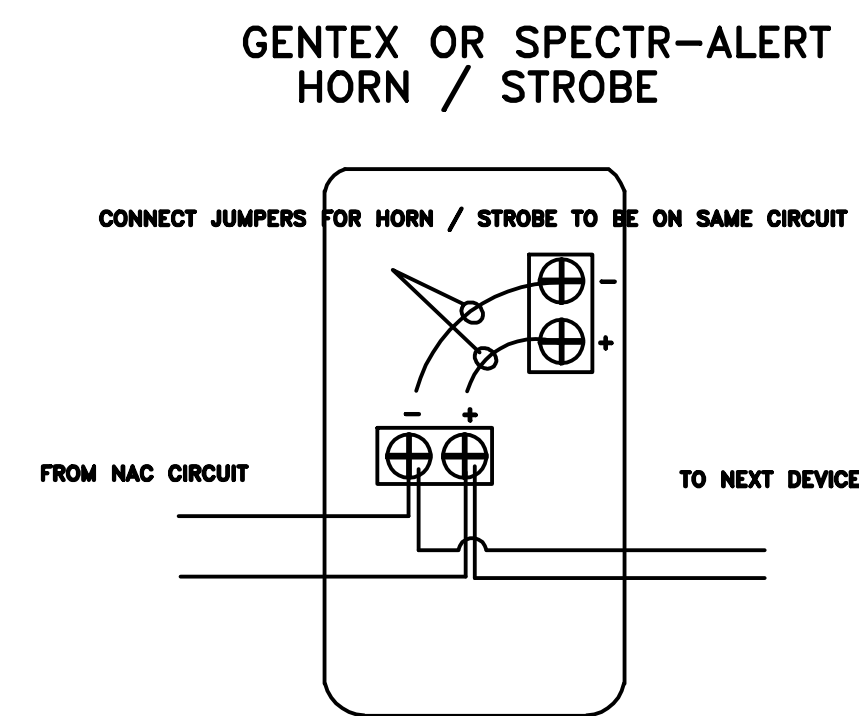

**NAC CIRCUITS SHALL BE: 16-2
NON-SHIELDED FIRE ALARM CABLE**

**SLC LOOP SHALL BE: 18-2 SHIELDED
FIRE ALARM CABLE.**

NOTE-
CONTRACTOR SHALL VERIFY FACP
REQUIREMENTS BEFORE INSTALLING
ANY CABLE.

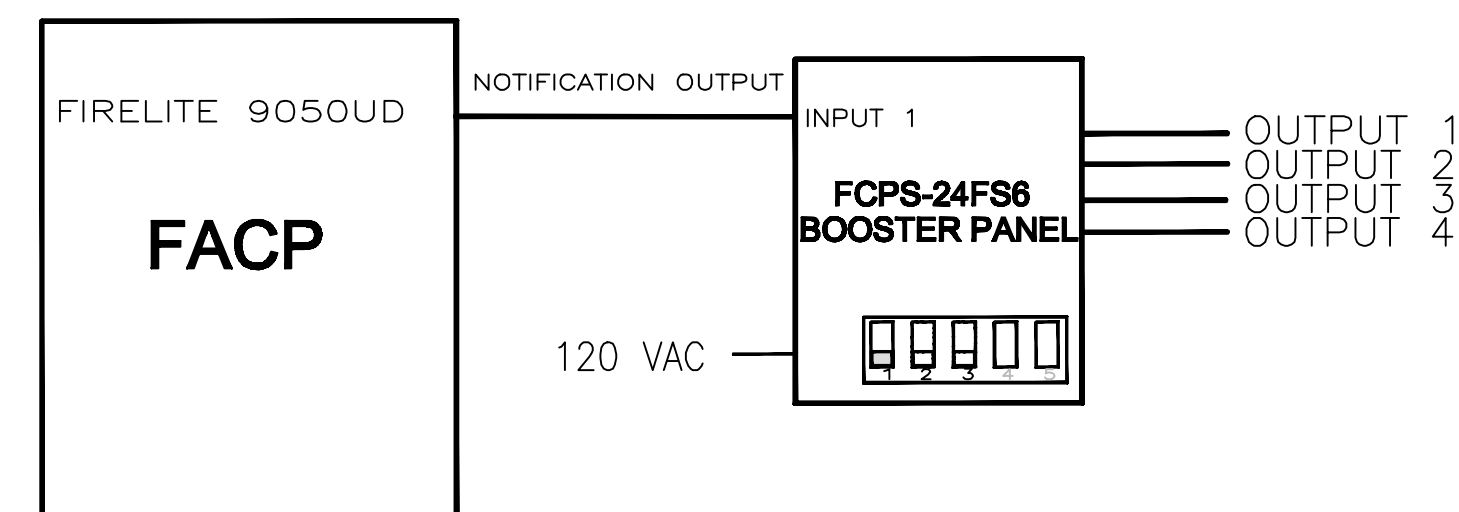


TYPICAL CONFIGURATION TO 24FS6 BOOSTER PANEL

NTS

CRF-300-6 CONTROL MODULE

NFPA 72 AND ADA DEVICE INSTALLATION REQUIREMENTS

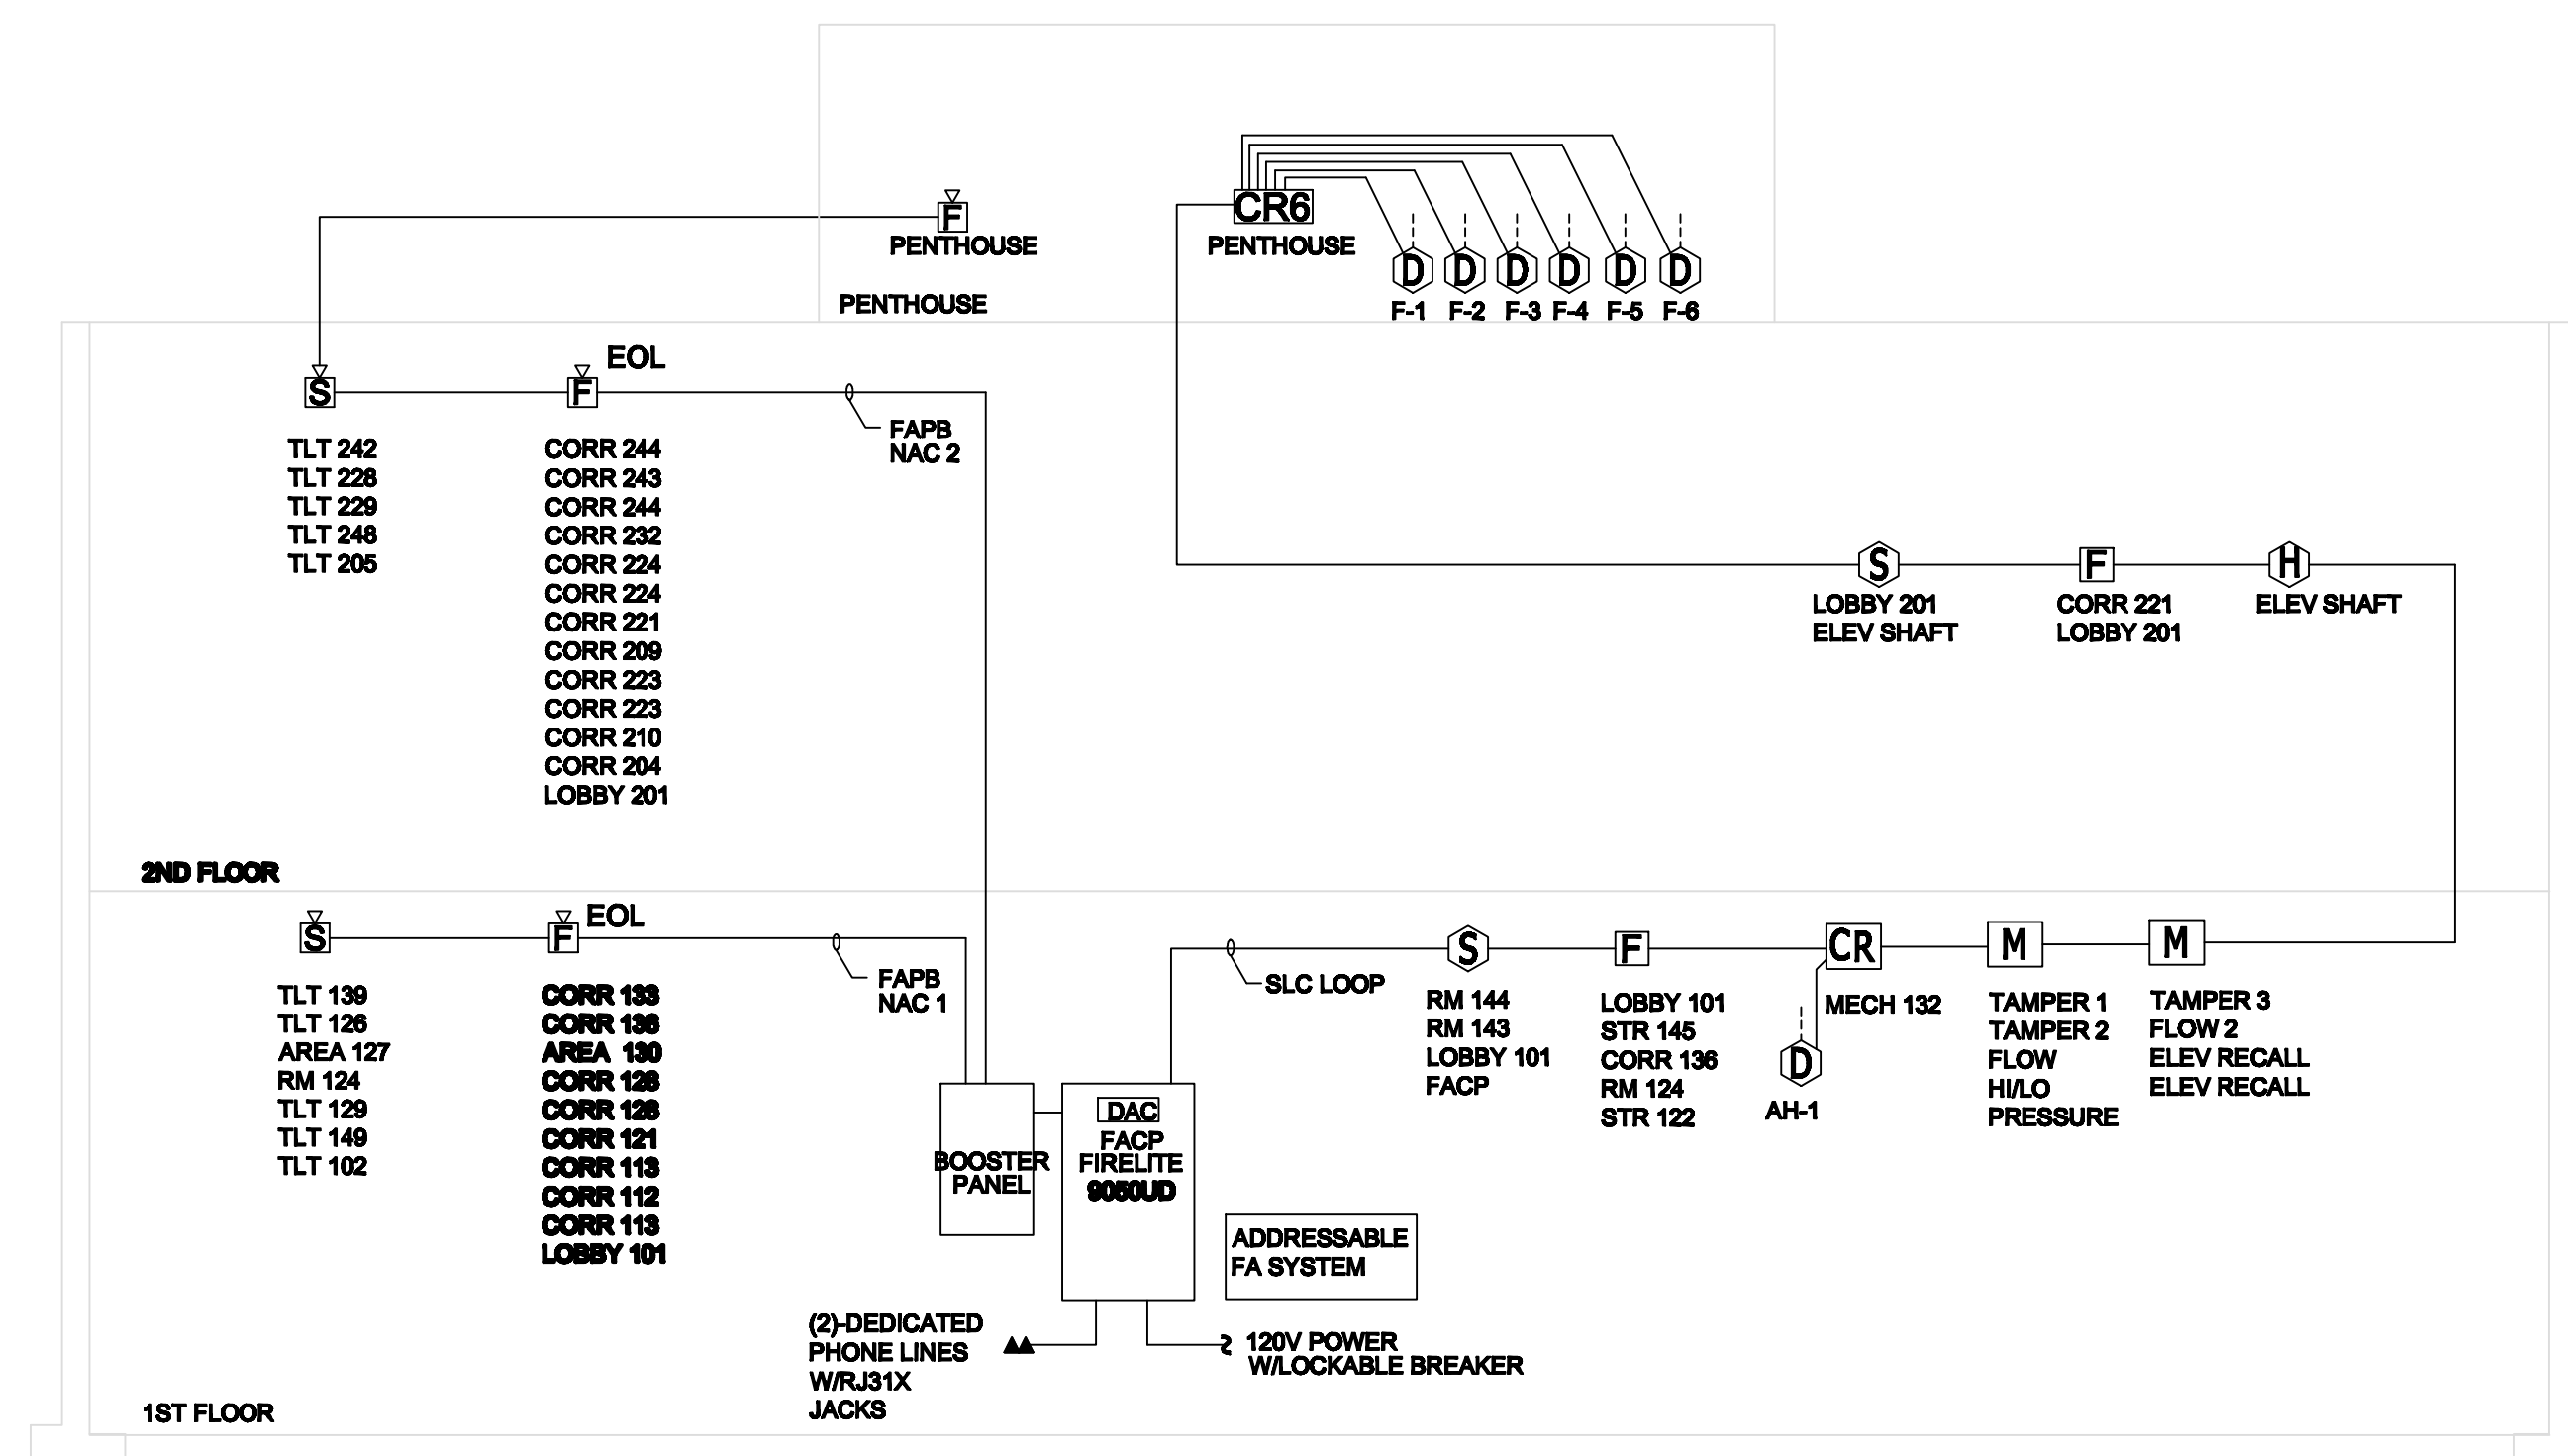

1 **FIRE ALARM RISER PLAN**
FA1 **NTS**

NT

**THE
PYROCADD
COMPANY,LLC**
A FIRE SYSTEM DESIGN FIRM
9713 SAINT JOHNS CHURCH RD
ZEBULON, NC 27597

PHONE: 919-375-4468

EMAIL: PYROCADD@GMAIL.COM

This drawing and the design shown are the property of THE PYROCADD COMPANY.
The reproduction, copying or other use of this drawing without their written consent is prohibited.
2006
THE PYROCADD COMPANY, LLC

NEW FIRE ALARM SYSTEM FOR:

ROCKY RIDGE TENANT BLDG.

**2470 ROCKY RIDGE ROAD
VESTAVIA HILLS, AL. 35216**

PROJECT NO:	102-20
-------------	--------

DATE: 3/27/09

CAD DWG FILE:

DRWN BY: DWR	CHKD BY: DWR
--------------	--------------

DETAILS RISER PLAN

FA1